




Leicestershire  
County Council

NOTES:

1. All dimensions are in millimetres unless otherwise stated.
2. Ducts to be sealed with expanding foam following successful testing of the cable network.
3. Dimensions of pillar to suit the size of the consumer unit, cable reduction terminals etc plus a 25% extra capacity.
4. Pillar to be fitted with three phase 12 way distribution board, 63A triple pole and neutral isolator and 12 No BS 88 fuse carriers.

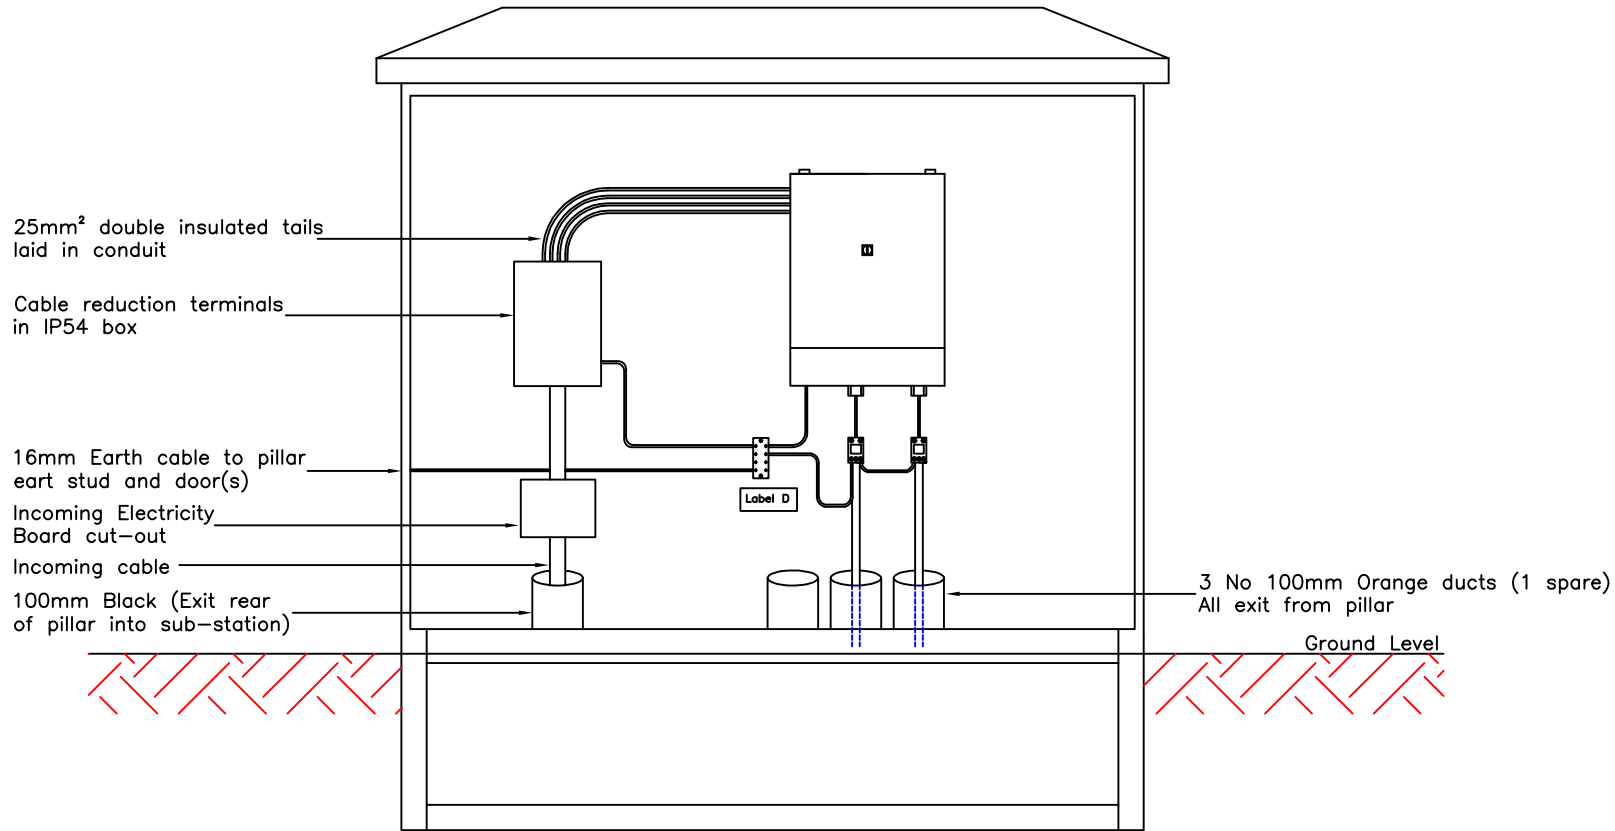

Leicestershire  
County Council

©Crown copyright 2007. All rights reserved. Use of this image is limited to viewing on-line and printing one copy. Leicestershire County Council. 100619271.

 **Leicestershire County Council**  
DEPARTMENT OF HIGHWAYS  
TRANSPORTATION AND  
WASTE MANAGEMENT 

TITLE:	STANDARD DRAWING	STREET LIGHTING
	THREE PHASE FEEDER PILLAR LAYOUT WITH 12 OUT-GOING WAYS	

DRAWING NUMBER	DATE			
SD/14/6	APRIL 2007			
AUTOCAD REF	SCALE			
K:\GENERAL\ID9997\STDDRG\SD146	NOT TO SCALE	Rev	Date	Notes on Revision