




Leicestershire
County Council

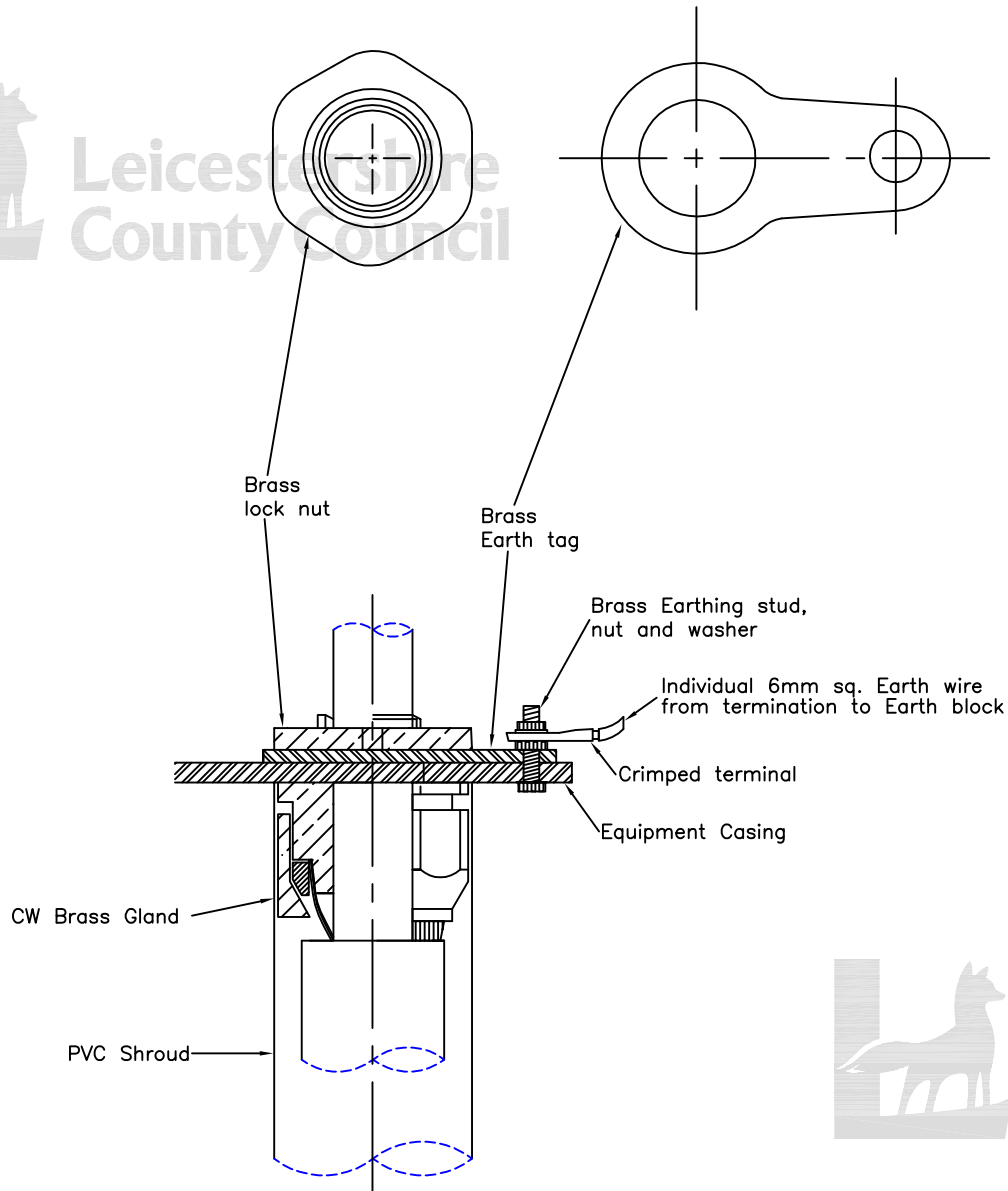

NOTES:

1. All dimensions are in millimetres unless otherwise stated.
2. Depth of gland plate not less than 55mm.
3. PVC shroud to be a tight fit on cable sheath and gland.
4. Label to be fitted below lock nut.
5. Colour identification shall be achieved via sleeving of the exposed core as follows:-

YELLOW	=	GREEN/YELLOW
BLUE	=	BLACK
BROWN	=	RED



Leicestershire
County Council

©Crown copyright 2007. All rights reserved. Use of this image is limited to viewing on-line and printing one copy. Leicestershire County Council. 100619271.



DEPARTMENT OF HIGHWAYS
TRANSPORTATION AND
WASTE MANAGEMENT



TITLE:	STANDARD DRAWING	STREET LIGHTING
	ARMoured CABLE TERMINATION	

DRAWING NUMBER	DATE				
SD/14/7	APRIL 2007				
AUTOCAD REF	SCALE				
K:\GENERAL\ID9997\STDDRG\SD147	NOT TO SCALE	Rev	Date	Notes on Revision	